


**EQUIVALENT FIRESAFE STANDARDS API 6A, API 607, BS 6755, ISO 10497**

Development of Firesafe Standards up to 2007

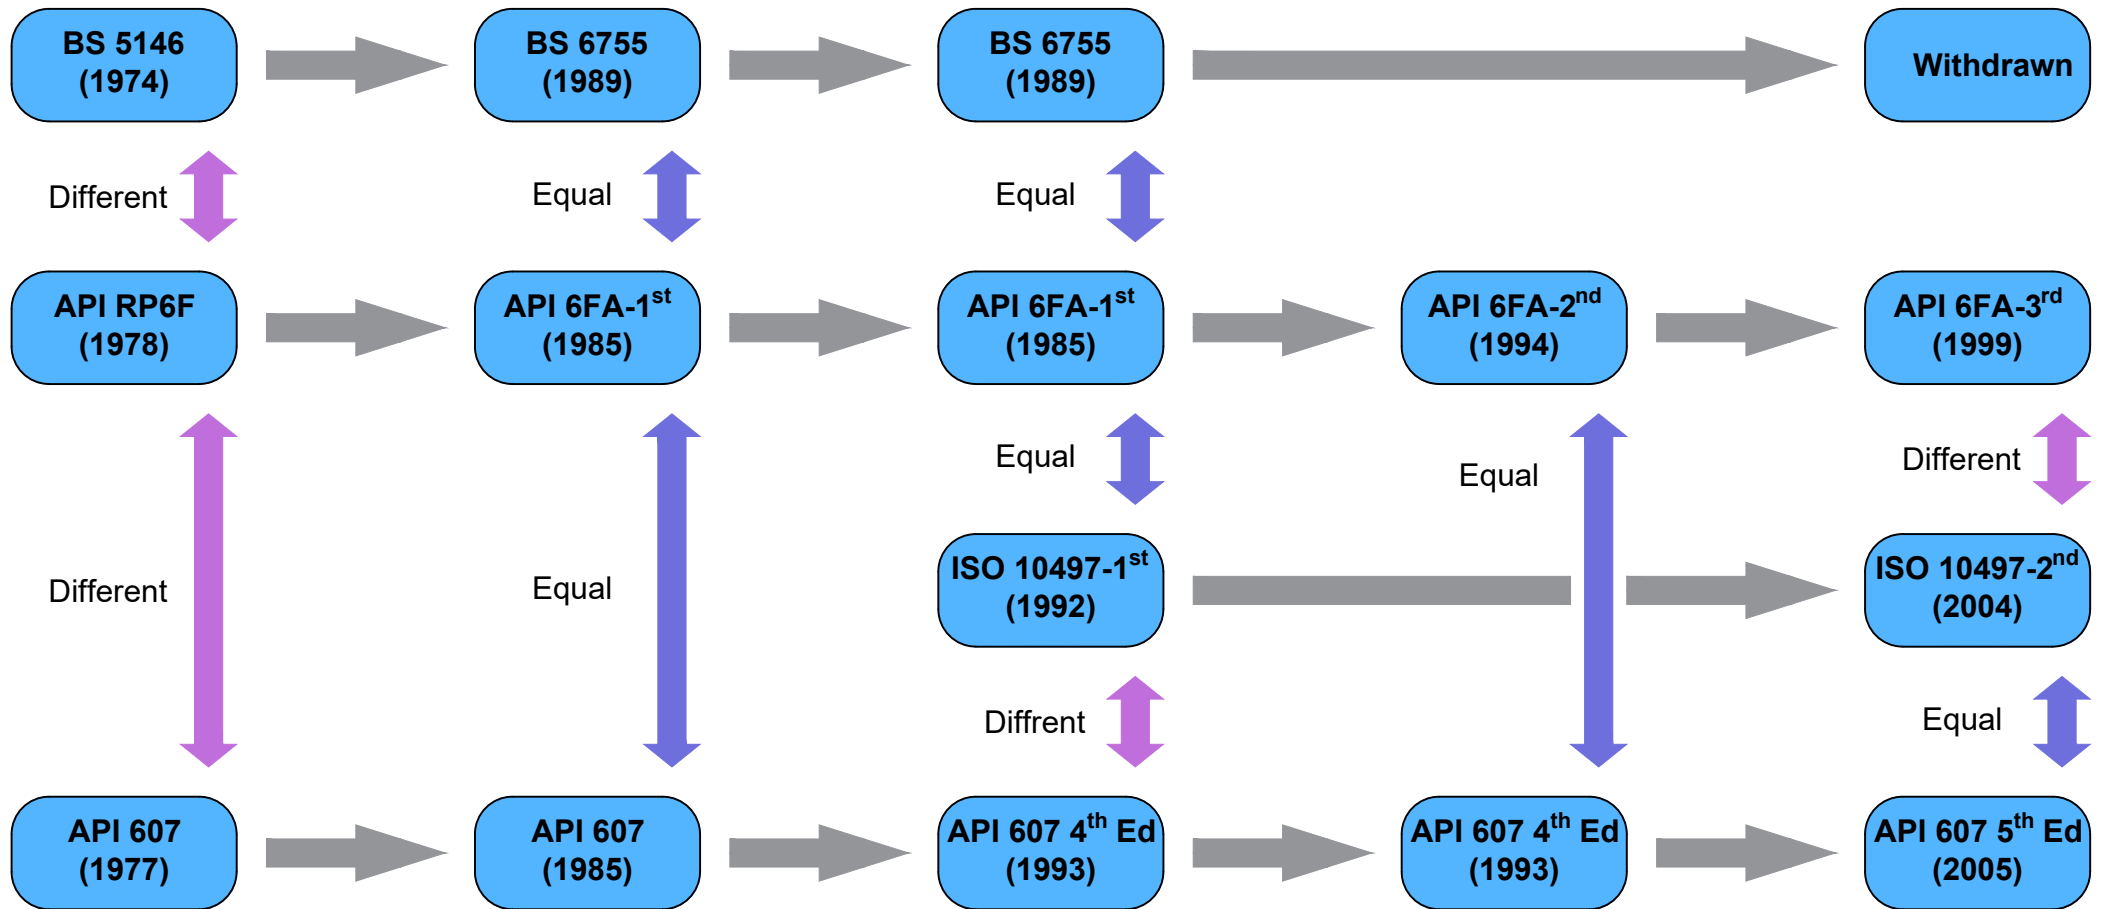

API 607 4th Edition & ISO 10497 - within 10 minutes after extinguishing the flames valve temperature must be below 100°C cooling with water spray. Rest of standards unforced cooling down. Through leakage after cool down is at 2 barg in ISO 10497:2004 and at 75% of maximum cold working pressure in the rest of standards.